ENGINEERED™ SOLUTIONS
A division of Morris/Lee, Ltd.™

321 Cityview Blvd
Unit #4
Vaughan, Ontario
L4H 3M3
905.832.0909
www.EngineeredSolutionsCan.com
Order@EngineeredSolutionsCan.com
www.rain-water.Solutions

Job:

Engineer:

S

Stilling Cistern Sensor Tree / Float Option

SIZE:
SCALE:
DATE:
APPROVED BY:
CHECKED BY:
DRAWN BY:

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA
DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

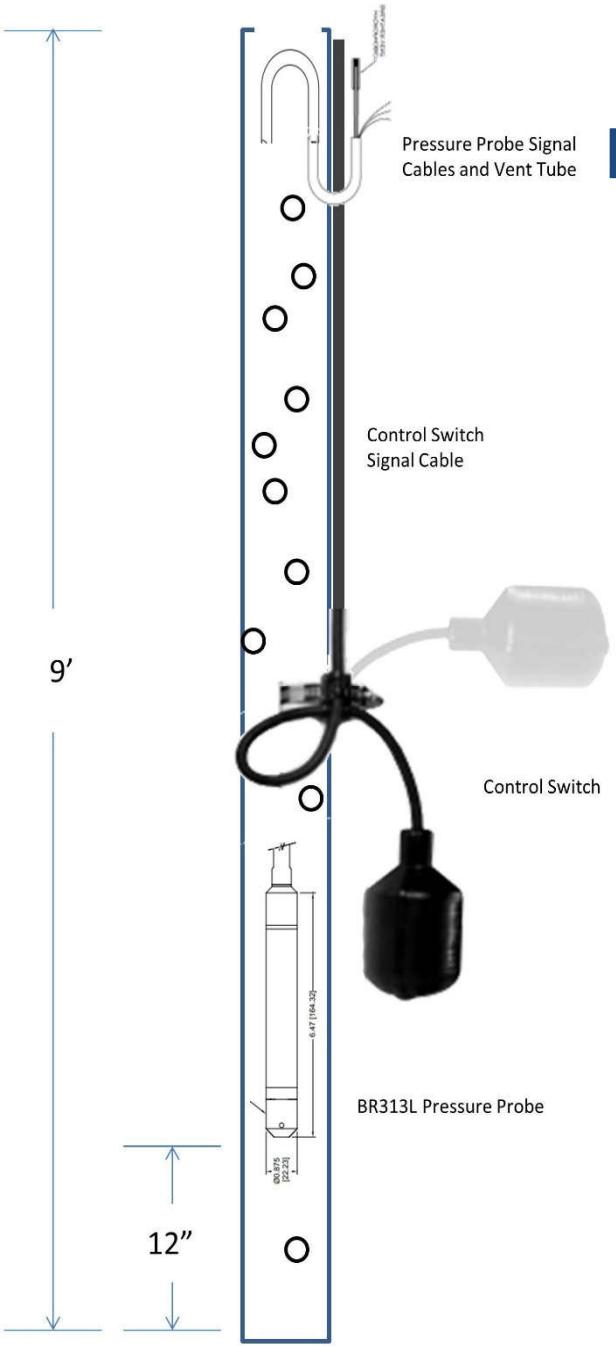

Options

9’ PVC Pipe Can be Cut to Suite

BR313L Pressure Sensor
24 VDC In 4-20 Ma Out

System Shut Off Float Assembly
24 V VDC Contact

- ☐ Include System Shut Off Float Assembly

FIGURE NUMBER	REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
								ES – SW- Float